


PA-020F 4' high, T-wall (with 160 PSF surcharge)
Standard Drawings Folder

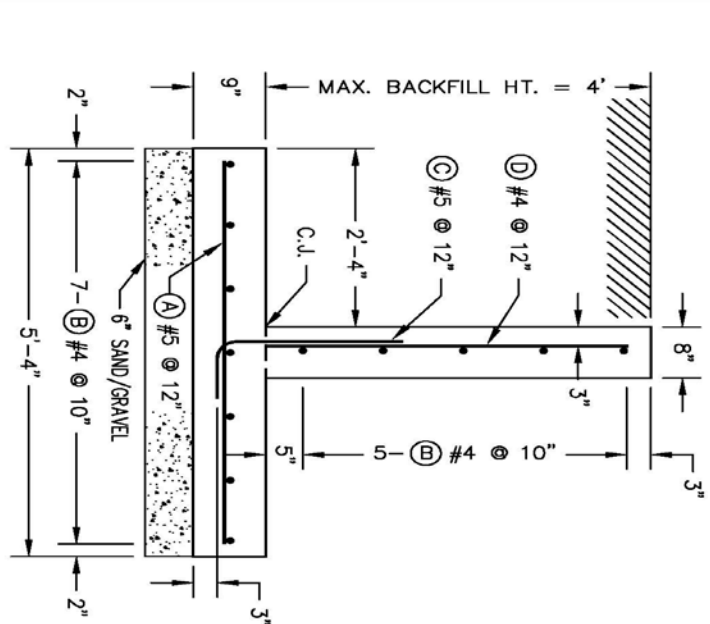

MARK	SIZE	QUAN	TYPE	R	S	LENGTH	TOTAL LENGTH
A	5		STR	---	---	5'-0"	
B	4		STR	---	---		
C	5		2	2'-0"	1'-0"	3'-0"	
D	4		STR	---	---	3'-9"	
L	4		2	2'-0"	9"	2'-9"	
LI	4		STR	---	---	3'-9"	

CONCRETE (0.25 CU. YDS./LIN. FT.) _____ CU. YDS.
STEEL #4 (16.55 FT./LIN. FT.) _____ FT.
STEEL #5 (8.0 FT./LIN. FT.) _____ FT.
STEEL (35.0 FT./CORNER) _____ FT.

TOTAL LENGTH OF WALL_____FT.

- NOTES:**
1. FOR FROST PROTECTION, A 2-FOOT BACKFILL IS RECOMMENDED.
 2. DIMENSIONS ARE TO THE REINFORCING BAR SURFACE.

C.J. = CONSTRUCTION JOINT

LIQUID-TIGHT JOINT ____ YES ____ NO

LIQUID-TIGHT JOINT OPTIONS

1) NON-METALLIC WATERSTOP (PVC)

2) HYDROPHILIC WATERSTOP

1. IF SLAB AND WALL ARE POURED SEPARATELY, THE SLAB SURFACE MUST BE THOROUGHLY CLEANED WITH WATER AND A NEW BRUSH. THE SURFACE OF THE JOINT SHALL BE KEPT MOIST FOR AT LEAST 1 HOUR PRIOR TO PLACEMENT OF NEW CONCRETE.
2. THE SLAB AND WALL MAY BE POURED AT THE SAME TIME, ELIMINATING THE NEED FOR A CONSTRUCTION JOINT.

4-FOOT WALL CORNER DETAILS	SEE PA-025
SLAB CORNER DETAILS	SEE PA-023
RESTRAINING SLAB OPTIONS	SEE PA-024

GENERAL DESIGN NOTES:

•DRAINAGE SHALL BE AWAY FROM THE WALL.

• THE MINIMUM TOP WIDTH OF THE BACKFILL AGAINST THE WALL SHALL BE EQUAL TO OR GREATER THAN THE BACKFILL HEIGHT.

• MAXIMUM FOOTING CONTACT PRESSURE IS 760 psf/ft.

DESIGN STRENGTHS: WORKING STRESS DESIGN

CONCRETE $f_c = 4,000$ psi STEEL $f_s = 20,000$ psi (GRADE 40)

WALL DESIGN LOADING: 313 STANDARD – LATERAL EARTH PRESSURE VALUES,

SEE SECTION IV OF THE FIELD OFFICE TECHNICAL GUIDE

- MANURE LOAD INSIDE = 65 psf/ft.

- SUL BACKFILL LOAD OUTSIDE = 85 psf/ft.
- 160 psf HORIZONTAL SURCHARGE OR A 2.5:1 SLOPING BACKFILL IS ALLOWED.

•SOIL BACKFILL DENSITY = 110 pcf.

•WATER TABLE MUST BE BELOW THE FOOTING ELEVATION

WALL RESTRAINT REQUIREMENTS:

• 5" THICK SLAB, SAFETY FACTOR AGAINST SLIDING 1.5 MIN.

BACKFILL HEIGHT (OUTSIDE LOAD)	SLAB LENGTH NO INSIDE LOAD	SLAB LENGTH FULL INSIDE LOAD
4 FEET	50 FEET	NO SLAB
3 FEET	29 FEET	NO SLAB
2 FEET	12 FEET	NO SLAB
1 FOOT	NO SLAB	2 FOOT **
0 FEET	NO SLAB	2 FOOT **

****MINIMUM SLAB LENGTH OF 2 FEET REQUIRED AND MUST BE TIED INTO THE WALL FOOTING.**

SLAB POURED WITH WALL FOOTING:

#3 BARS @ 18" SPACING (MINIMUM REINFORCEMENT)

SLAB NOT POURED WITH WALL FOOTING

#3 DOWEL BARS - 3'-0" LENGTH @ 7'-0" SPACING

THIS STANDARDIZED DESIGN MUST BE ADAPTED TO THE SPECIFIC SITE. IT WAS DEVELOPED IN COOPERATION WITH THE WISCONSIN DEPARTMENT OF AGRICULTURE, TRADE AND CONSUMER PROTECTION. THE DESIGN FOLDER IS FILED AT THE MARIS STATE OFFICE, 8030 EXCELSIOR DRIVE, MADISON, WI. 53717-2806

(ADAPTED FROM WI-545, APRIL 2005)